


## S.S. Step Activator Data:

Desired Duration Of Time:


Adjustable

(For water activities once sensor is activated)

Recommended Distance From Step Pad Activator(s) to  
Control Panel 50' Max

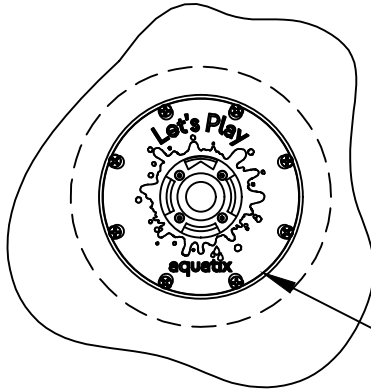

Sealed textured cover with  
security screws for removal  
(Custom engraving available)

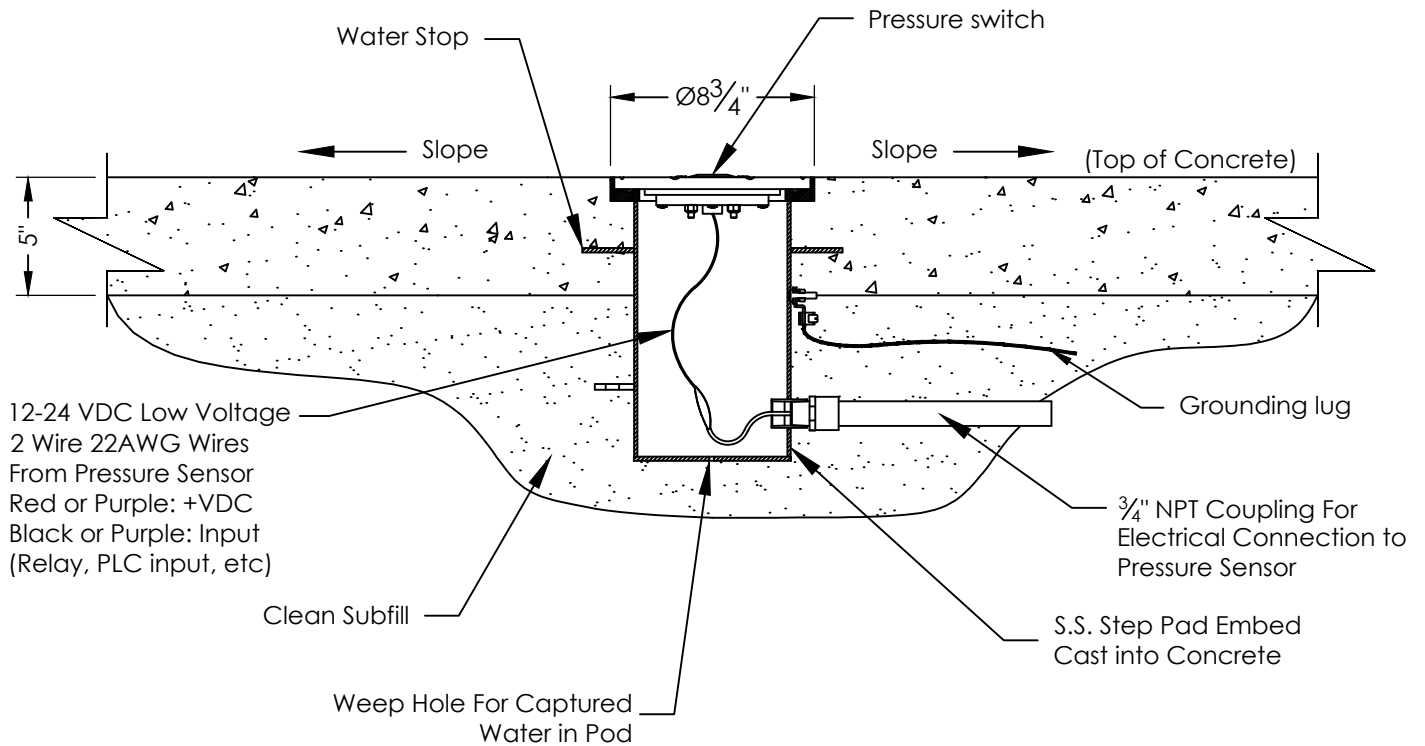

## Step Pad Activator:

Model No.

Description

ACT-FM

Activation Pad



1101 McKinley Parkway  
Delano, MN 55328  
888-438-6574  
763-972-5200  
aquatix.playlsi.com

## SS FLUSH-MOUNT STEP ACTIVATOR

DRAWN  
BY P.J.

SCALE 1 1/2" = 1'-0"

DATE 2/3/21

REVISED  
BY NCS

REVISION  
LETTER B

REVISION  
DATE 2/6/2025

This drawing is issued in confidence for engineering information only. This drawing shall remain the property of Aquatix and may not be reproduced, disclosed to a third party, or used to manufacture anything without direct written permission from Aquatix. Unauthorized use shall entitle Aquatix to all damages caused by such user including preparation charges, lost profits, damage to reputation and attorney's fees.